


Large Groundwater Withdrawal Permit - Groundwater Level Monitoring

Town	Epping
Permittee	Town of Epping Water and Sewer Department
Permit Number	LGWP-2012-0001
Station ID	20120001DW04
Station Name	DRINKING WELL HOUSE #4
Approximate Distance from Permitted LGW Well(s)	1,290 feet
Local Aquifer	Bedrock
Well Depth	505 feet
Top of Casing Altitude	220 feet (Elevation Datum Unknown)

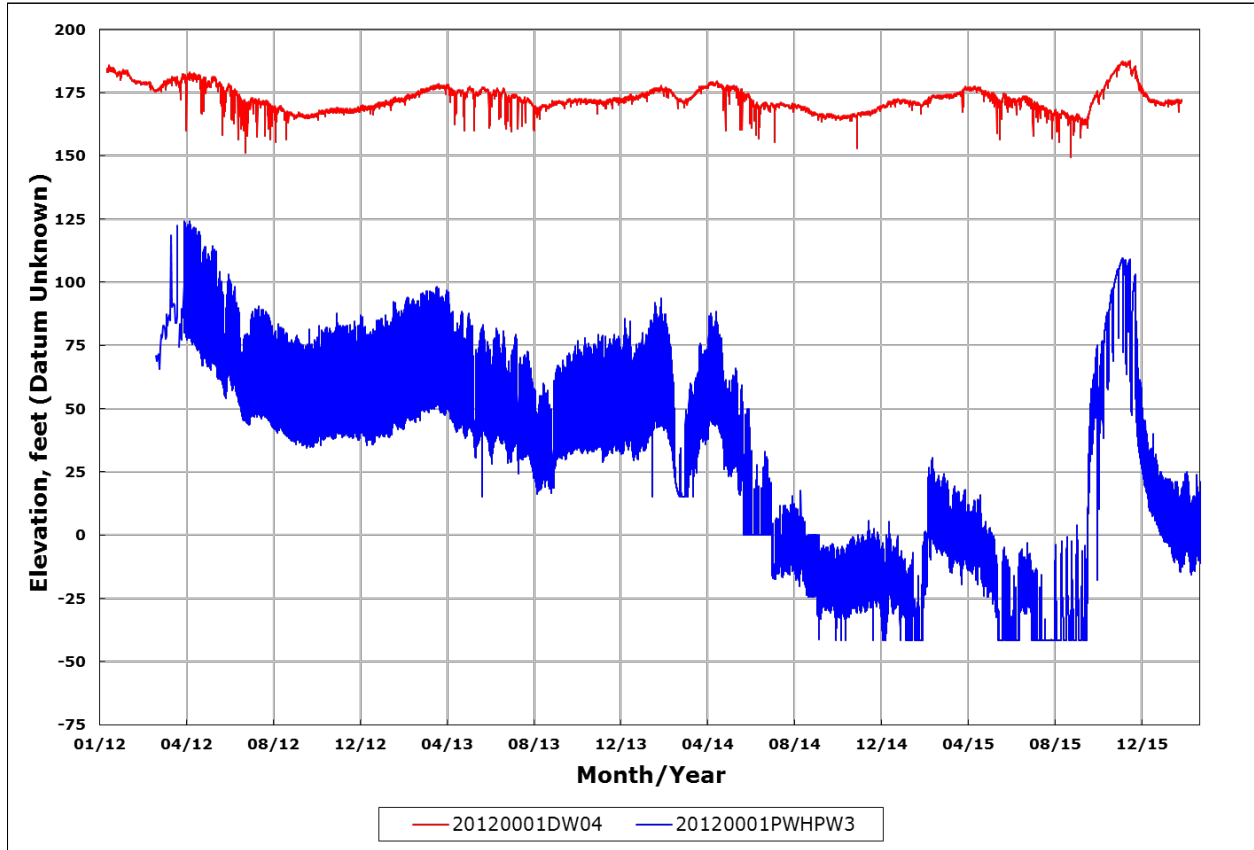

REMOVED FROM MONITORING NETWORK IN 2016